


PLD

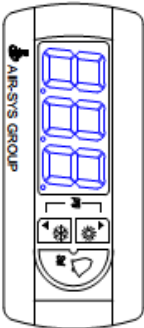


MC MF2 EH
L 1 2 3 43 44 45 46 47



MC MF2 EH
1' 2' 3' 51 52 48 49 50

ASLLC.2

Airsys WPU1

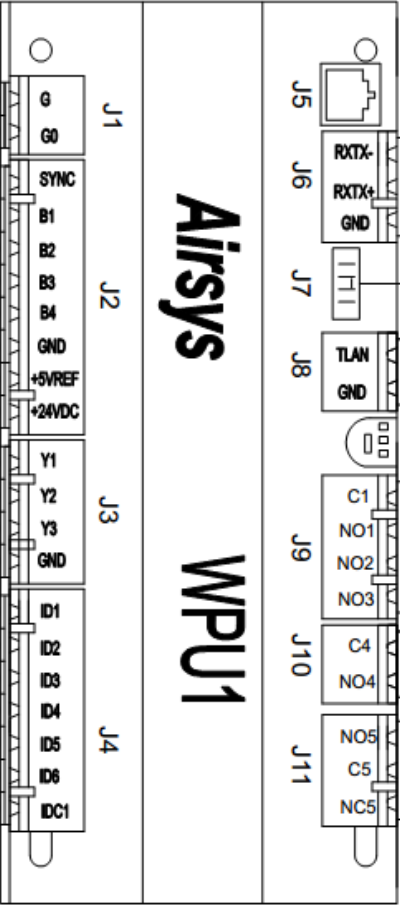

Airsys WPU2

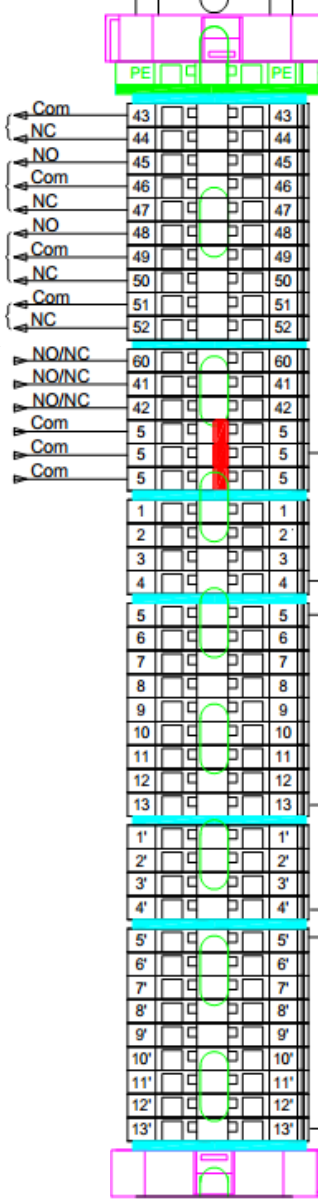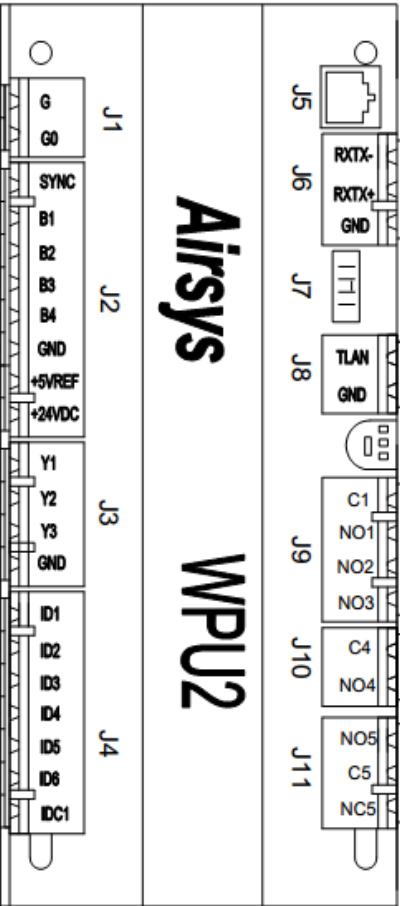

S.N.	Mark	Name
1	Alarm output	Alarm output
2	CL	Current Input
3	RS485	RS485 Serial Card
4	DG	Diesel Generator Status
5	FA	Smoke/Fire Alarm
6	EH1-3	Electric heat
7	PF	Air Pressure Differential switch
8	LP	Low-pressure switch
9	HP	High-pressure switch
10	MC	Compressor
11	MF2	Supply fan
12	YE	Air damper actuator
13	UG	AC to DC convertor
14	SH	Outdoor humidity Sensor
15	PLD	PLD user terminal
16	PCOs	Control board
17	ST1	Return temperature sensor
18	ST1'	Return temperature sensor (backup)
19	ST2	Outdoor temperature sensor
20	QF	Micro breaker